



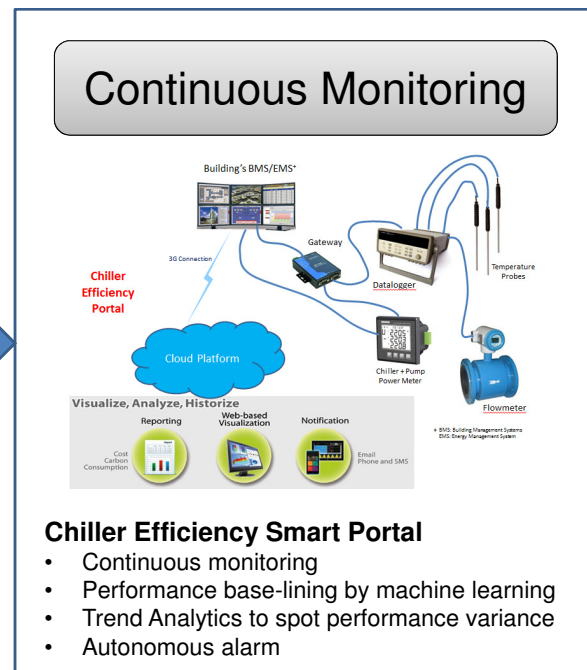


Piloting a New Paradigm for Continuous Commissioning of Chiller Plant

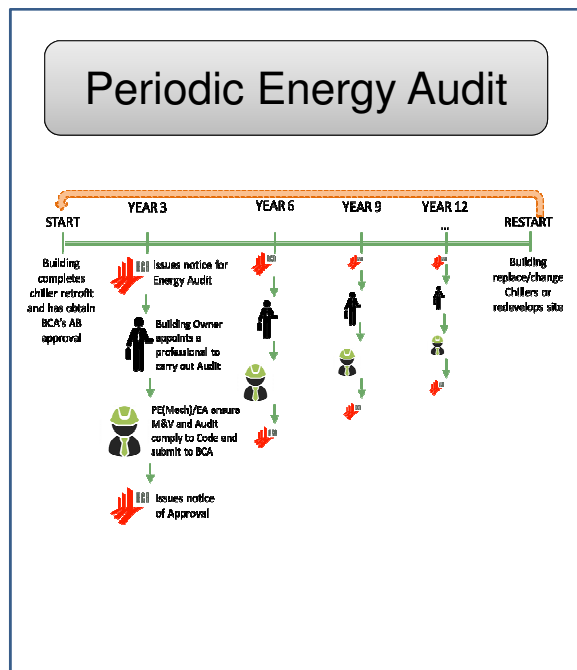


How to Make it Easy for Industry to Connect - Standardised Interface

- BCA
 - Publish the interface and installation examples
- Building Owners
 - Direct feed, or
 - Feed in from their iBMS
- Portal Service Provider
 - Feed in for their subscribers

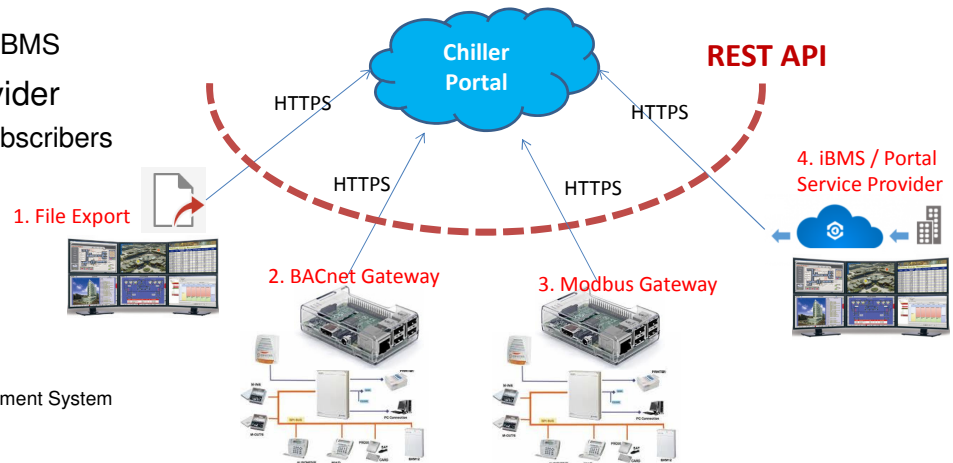


* iBMS = Integrated Building Management System

Demo – Facilitate Energy Audit (OSE) Report Generation

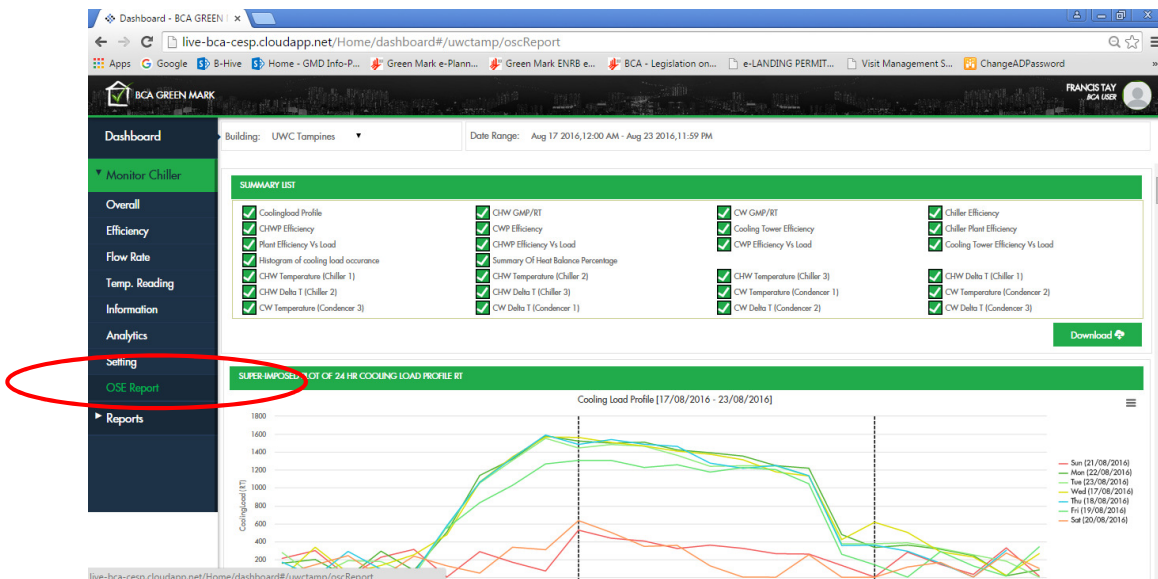

Demo – Analysis for Trouble shooting

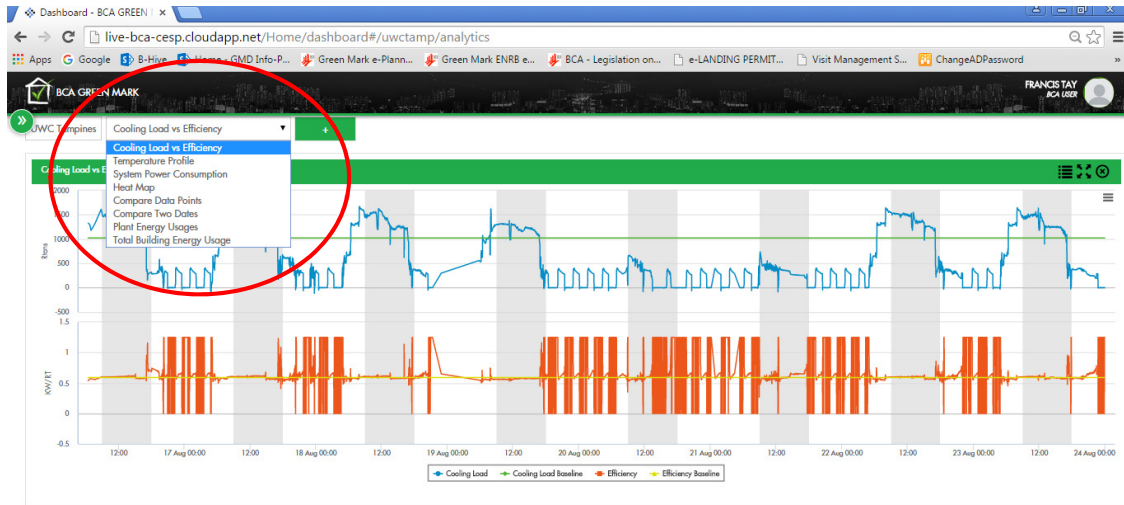

Demo – Baseline & Alert Rules

The screenshot shows the 'Alert Rule Setup' interface. The 'ALERT RULE' tab is selected. The form includes the following fields:

- Building: UWC Tampines
- Object: Chiller
- Data Field: Efficiency
- Notify User: Select User
- Severity: Major
- Value(%): 10
- Condition: Above
- Send Via: Email SMS

Buttons: CLEAR, SAVE

Search: search by any column

Object	Data Field	Notify User	Severity	Value(%)	Condition	Email	SMS	Edit
system	efficiency	admin	Minor	10	Above	Yes	No	Edit

Benefits For Building Owners

- Entry-level remote monitoring
- Generation of audit report
- Lower cost of compliance

